

EXACOR™

Sound & Fire Assemblies Handbook





Overview

This handbook is intended to provide general information regarding assemblies that have been evaluated for fire-resistance and/or for acoustical attenuation performance. The assemblies presented in this handbook feature EXACOR® panels installed as part of an assembly of materials and tested and evaluated in accordance with the following standards:

Fire-Resistance Testing

- ASTM E119 Standard Test Methods for Fire Tests of Building Construction and Materials / ANSI UL 263 Fire Tests of Building Construction and Materials

Sound Assembly Testing

- ASTM E90 Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions
- ASTM E413 Classification for Rating Sound Insulation
- ASTM E492 Standard Test Method for Laboratory Measurement of Impact Sound Transmission Through Floor-Ceiling Assemblies Using the Tapping Machine
- ASTM E989 Classification for Determination of Impact Insulation Class
- ASTM E2235 Standard Test Method for Determination of Decay Rates for Use in Sound Insulation Test Methods
- ASTM E3222 Standard Classification for Determination of High-Frequency Impact Sound Ratings

The information contained in this handbook is for guidance and reference only. Please refer to the applicable fire-resistance rated assembly published by Underwriter's Laboratory (UL) or ICC-ES for full assembly details, requirements, and options. Some fire-resistance rated assemblies contain multiple material and installation options that may have an impact on sound performance. Not all the available options in each fire-resistance rated design listing have been tested for STC/IIC ratings. Please see ICC-ES ESL-1365 for more detailed information regarding assemblies tested to ASTM E90 and E492.

Please note that this handbook may also include sound assemblies that have NOT been evaluated for fire-resistance. The level of fire-resistance (if any) for each assembly is presented at the top of the page for each assembly configuration. Follow all local building code requirements for fire-resistance and sound transmission.

Each assembly presents information for the assembly without a floor covering. This information is meant to represent the base level of performance for the given assembly. EXACOR® panels should always be covered by an appropriate finished floor covering. Please see the EXACOR® Subfloor Installation Manual and EXACOR® Underlayment Installation Manual available at www.exacor.com for more information.



Table of Contents

Overview	2
Fire-Resistance Testing	2
Sound Assembly Testing	2
Floor/Ceiling Assemblies	4
Fire-Resistance & Sound Ratings	4
Fire-Resistance Rated Floor/Ceiling Designs	4
EXACOR® Underlayment	
Wood Truss	5
UL L528 - System No. 22	5
UL L546 - System No. 14	5
Wood I-Joist	6
UL L570 - System No. 20	6
UL L602 - System No. 2	6
2x10 Joist	7
UL L501 - System No. 23	7
UL L502 - System No. 24	7
UL L511 - System No. 25	8
UL L525 - System No. 16	8
Wood Truss	9
UL M500 - System No. 9	9
EXACOR® Subfloor	
Wood Truss	10
UL L601	10
Wood I-Joist	11
UL L602	11
2x10 Joist	12
UL L502 - System No. 25	12
UL L525 - System No. 17	12
Wood Truss	13
UL M500 - System No. 10	13
Fire-Resistance Rated Wall Assemblies	14
Fire-Resistance Ratings	14
Applications and Uses	14
Exterior Walls	15
Townhome Unit Separation	15
ICC Design No. MOS-1290-03	16
ICC Design No. MOS-1290-04	16
ICC Design No. MOS-1290-06	17
ICC Design No. MOS-1290-08	17
ICC Design No. MOS-1290-07A	18
ICC Design No. MOS-1290-07B	19



Floor/Ceiling Assemblies

Fire-Resistance & Sound Ratings

This section contains STC and IIC ratings for floor/ceiling assemblies that are based on designs that have been assessed for fire-resistance in accordance with ASTM E119/ANSI UL 263. See specific fire-resistance rated Design Listing from UL for full assembly details and requirements. Follow all local building code requirements for fire-resistance and sound transmission.

Fire-Resistance Rated Floor/Ceiling Designs	
EXACOR® Underlayment:	EXACOR® Subfloor:
-UL L501 (System No. 23) - 1hr	-UL L502 (System No. 25) - 1hr
-UL L502 (System No. 24) - 1hr	-UL L525 (System No. 17) - 1hr
-UL L511 (System No. 25) - 2hr	-UL L601 - 1hr
-UL L525 (System No. 16) - 1hr	-UL L602 - 1hr
-UL L528 (System No. 22) - 1hr	-UL M500 (System No. 10) - 2hr
-UL L546 (System No. 14) - 1hr	
-UL L570 (System No. 20) - 1hr	
-UL L602 (System No. 2) - 1hr	
-UL M500 (System No. 9) - 2hr	


EXACOR® UNDERLAYMENT

Wood Truss

UL L528 - System No. 22

UL L546 - System No. 14

1hr Fire-Resistance

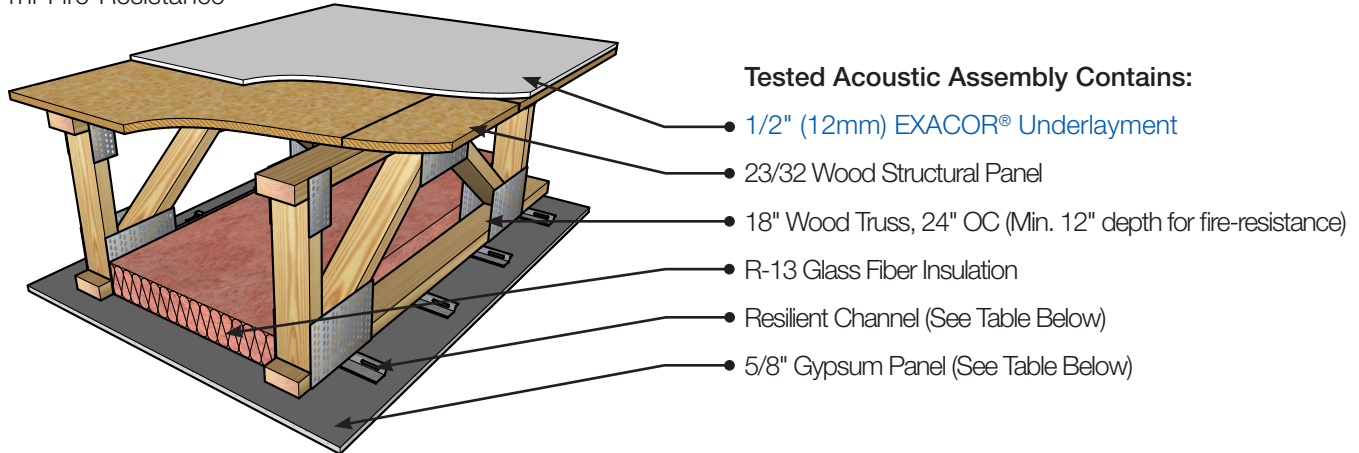

*See applicable UL Design for full assembly details and requirements.

Acoustical Performance - EXACOR® Underlayment				
Floor Covering	None*	2mm Luxury Vinyl	2mm Luxury Vinyl	5.5mm Luxury Vinyl (Floated)
Sound Attenuation Mat		None	1.4mm Sound Mat	None
Ceiling Option 1				
Furring Type	Resilient Channel (RC-1) Spaced 16” On Center			
Gypsum Panel	5/8 ULIX™Gypsum			
STC/IIC	57/50	58/52	58/53	59/54
HIIC	51	54	63	59
Report No.	L9005.01-113-11-R0	L9005.02-113-11-R0	L9005.03-113-11-R0	L9005.04-113-11-R0
Ceiling Option 2				
Furring Type	Resilient Channel (RC-1) Spaced 16” On Center			
Gypsum Panel	5/8” Type C Gypsum (Type AG-C required for fire-resistance rating)			
STC/IIC	58/51	59/54	59/55	60/56
HIIC	52	59	68	61
Report No.	L6141.26-113-11-R0	L6141.27-113-11-R0	L6141.28-113-11-R0	L6141.29-113-11-R0
Ceiling Option 3				
Furring Type	Resilient Channel (RC-1) Spaced 12” On Center			
Gypsum Panel	5/8” Type C Gypsum			
STC/IIC	59/47	59/50	59/51	60/52
HIIC	49	55	64	57
Report No.	L9602.01-113-11-R0	L9602.02-113-11-R0	L9602.03-113-11-R0	L9602.04-113-11-R0

*Assembly shown without floor covering for information purposes only. EXACOR® panels must be covered by a finish flooring material.


EXACOR® UNDERLAYMENT

Wood I-Joist

UL L570 - System No. 20

UL L602 - System No. 2

1hr Fire-Resistance

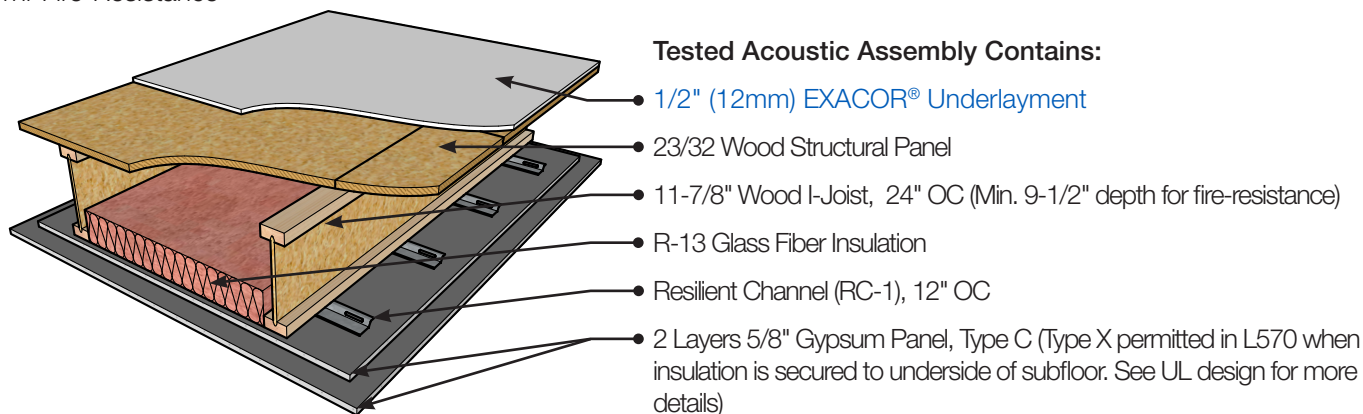

*See applicable UL Design for full assembly details and requirements.


Acoustical Performance - EXACOR® Underlayment					
Floor Covering	None*	2mm Luxury Vinyl	5.5mm Luxury Vinyl (Floated)	3/8" Engineered Wood Flooring	Carpet Tile
Sound Attenuation Mat		None	None	None	None
STC/IIC**	58/50	58/55	59/57	59/57	58/58
HIIC	49	56	59	62	74
Report No.	M2981.01-113-11-R1	M2981.02-113-11-R1	M2981.03-113-11-R1	M2981.04-113-11-R1	M2981.05-113-11-R1

*Assembly shown without floor covering for information purposes only. EXACOR® panels must be covered by a finish flooring material.

**Based on Type C Gypsum Panels

2x10 Joist

UL L501 - System No. 23
1hr Fire-Resistance

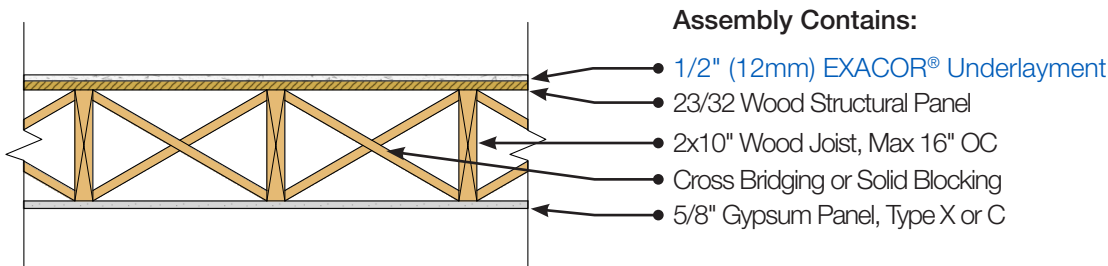


*See applicable UL Design for full assembly details and requirements.

Acoustical Performance - EXACOR® Underlayment
No Data

2x10 Joist

UL L502 - System No. 24
1hr Fire-Resistance

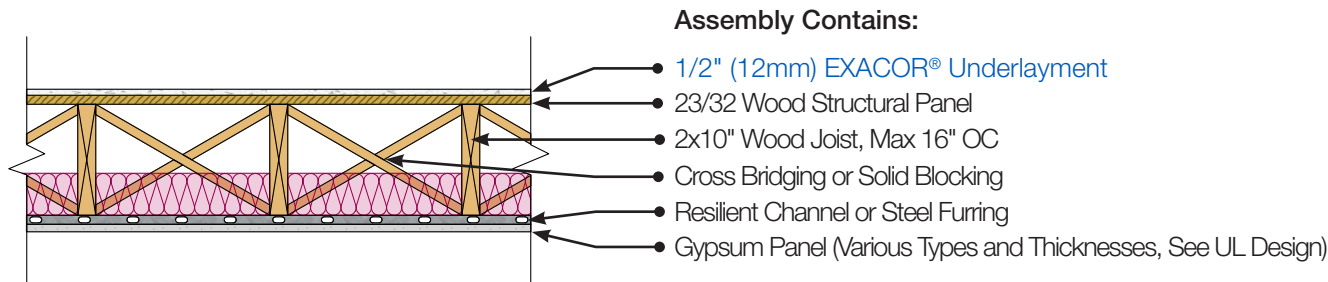


*See applicable UL Design for full assembly details and requirements.

Acoustical Performance - EXACOR® Underlayment
No Data

EXACOR® UNDERLAYMENT

2x10 Joist

UL L511 - System No. 25
2hr Fire-Resistance

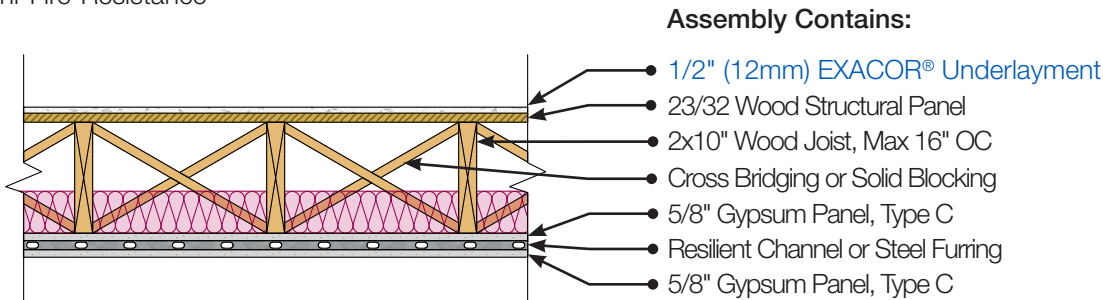


*See applicable UL Design for full assembly details and requirements.

Acoustical Performance - EXACOR® Underlayment

No Data

2x10 Joist

UL L525 - System No. 16
1hr Fire-Resistance

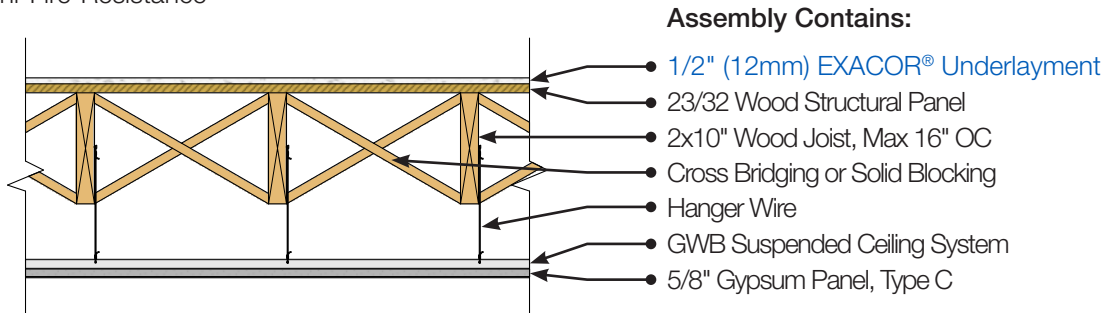

*See applicable UL Design for full assembly details and requirements.


Acoustical Performance - EXACOR® Underlayment

No Data

EXACOR® UNDERLAYMENT

Wood Truss

UL M500 - System No. 9
2hr Fire-Resistance

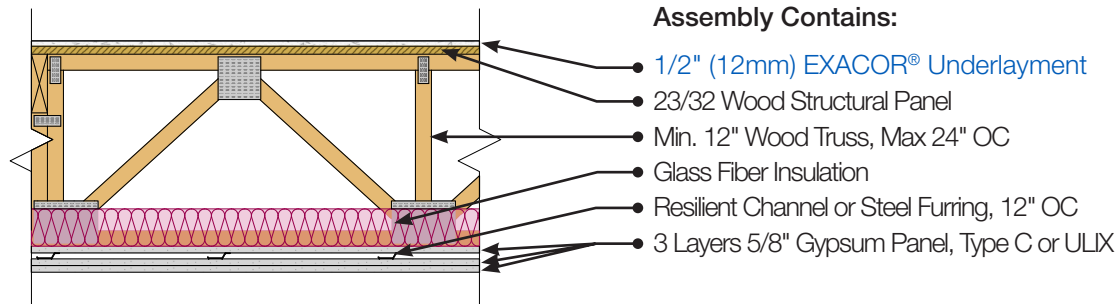


*See applicable UL Design for full assembly details and requirements.

Acoustical Performance - EXACOR® Underlayment
No Data

EXACOR® SUBFLOOR

Wood Truss

UL L601
1hr Fire-Resistance

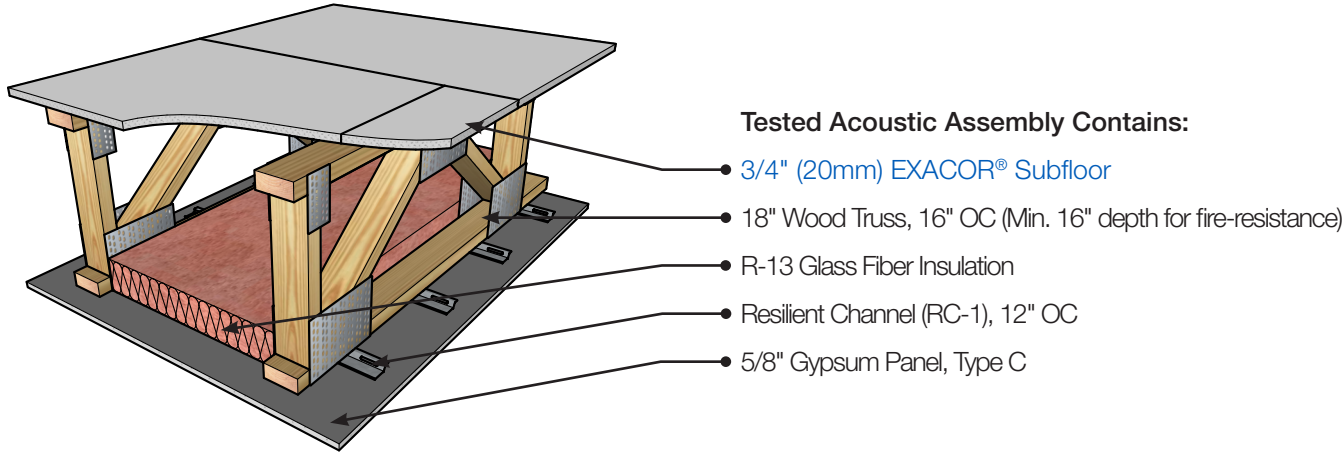

*See applicable UL Design for full assembly details and requirements.


Acoustical Performance - EXACOR® Subfloor					
Floor Covering	None*	2mm Luxury Vinyl	7mm Click-Lock LVP with Attached Pad	3/8" Engineered Wood Flooring	Carpet Tile
Sound Attenuation Mat		1.4mm Sound Mat		None	None
STC/IIC	54/39	55/50	55/50	56/50	54/51
HIIC	39	60	60	56	72
Report No.	FC23-0586	FC23-0595	FC23-0592	FC23-0585	FC23-0587

*Assembly shown without floor covering for information purposes only. EXACOR® panels must be covered by a finish flooring material.

EXACOR® SUBFLOOR

Wood I-Joist

UL L602
1hr Fire-Resistance

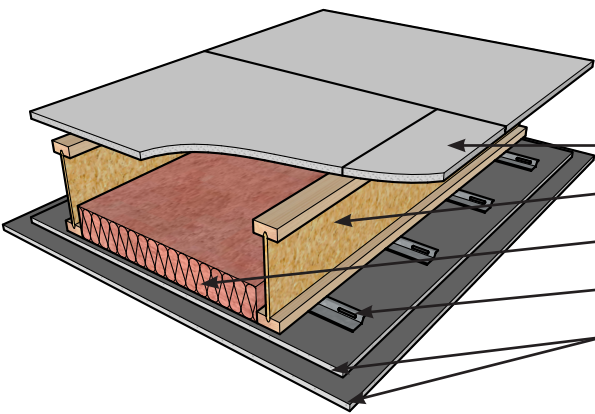

Tested Acoustic Assembly Contains:

- 3/4" (20mm) EXACOR® Subfloor
- 11-7/8" Wood I-Joist, 24" OC¹ (Min. 9-1/2" depth for fire-resistance)
- R-13 Glass Fiber Insulation
- Resilient Channel (RC-1), 12" OC
- 2 Layers 5/8" Gypsum Panel, Type C

1. 3/4" EXACOR panels used as subfloor are limited to a maximum span of 16" OC.

*See applicable UL Design for full assembly details and requirements.


Acoustical Performance - EXACOR® Subfloor					
Floor Covering	None*	2mm Luxury Vinyl	5.5mm Luxury Vinyl (Floated)	3/8" Engineered Wood Flooring	Carpet Tile
Sound Attenuation Mat		1.4mm Sound Mat	None	None	None
STC/IIC	55/40	56/52	57/50	57/51	56/54
HIIC	39	57	50	50	66
Report No.	M2981.06-113-11-R1	M2981.08-113-11-R1	M2981.09-113-11-R1	M2981.10-113-11-R1	M2981.11-113-11-R1

*Assembly shown without floor covering for information purposes only. EXACOR® panels must be covered by a finish flooring material.

EXACOR® SUBFLOOR

2x10 Joist

UL L502 - System No. 25
1hr Fire-Resistance

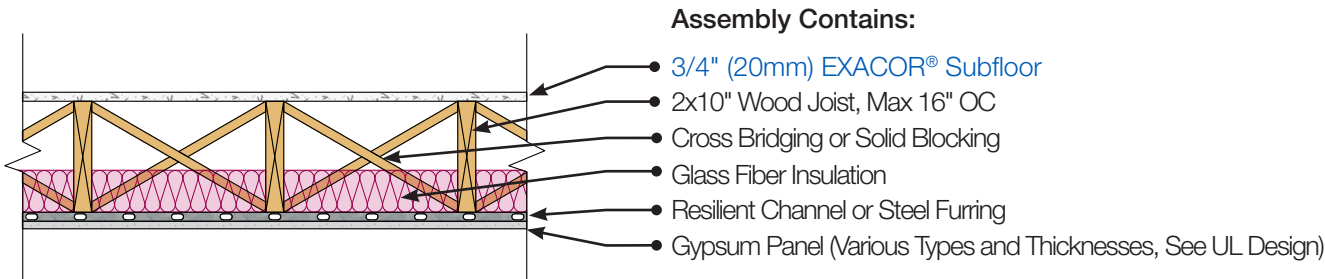


*See applicable UL Design for full assembly details and requirements.

Acoustical Performance - EXACOR® Subfloor
No Data

2x10 Joist

UL L525 - System No. 17
1hr Fire-Resistance

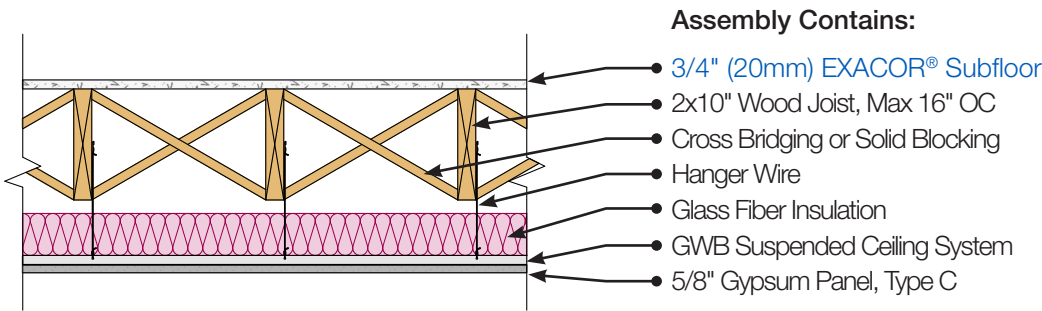


*See applicable UL Design for full assembly details and requirements.

Acoustical Performance - EXACOR® Subfloor
No Data

EXACOR® SUBFLOOR

Wood Truss

UL M500 - System No. 10
2hr Fire-Resistance

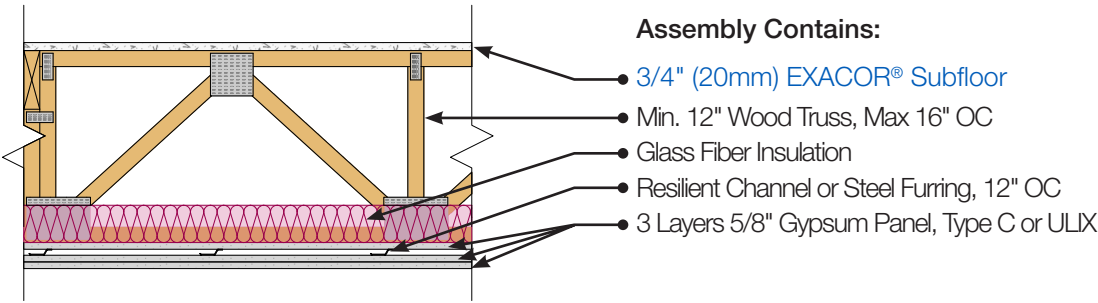

*See applicable UL Design for full assembly details and requirements.

Acoustical Performance - EXACOR® Subfloor
No Data

*See applicable UL Design for full assembly details and requirements.

Acoustical Performance - EXACOR® Subfloor
No Data



Fire-Resistance Rated Wall Assemblies

Fire-Resistance Ratings

This section contains descriptions of wall assemblies that have been tested in accordance with ASTM E119/ANSI UL 263 for fire-resistance or in accordance with NFPA 285 Standard Fire Test Method for Evaluation of Fire Propagation Characteristics of Exterior Wall Assemblies Containing Combustible Components. Calculations for fire-resistance rated load-bearing walls are based on the 2018 National Design Specification for Wood Construction® (NDS®) design procedures and in accordance with ASTM D6513 Standard Practice for Calculating the Superimposed Load on Wood-Frame Walls for Standard Fire-Endurance Tests. Unless otherwise noted, all superimposed wall loads were calculated assuming walls were braced by sheathing.

Applications and Uses

Code-compliance for EXACOR® sheathing is provided in ICC-ES ESR-4635 as an exterior sheathing material suitable for use in Construction Types III and V as defined by the International Building Code (IBC). Fire-resistance rated wall assemblies evaluated for use with EXACOR® sheathing can be found in ICC-ES [ESL-1290](#). Typical applications include load-bearing exterior walls and use as part of an assembly to meet townhome unit separation requirements under the International Residential Code (IRC).

EXACOR® Wall Sheathing

Typical Applications for EXACOR Fire-Resistance Rated Wall Designs

ICC Design No.	Typical Application & Construction Type	Fire-Resistance Rating	
		Interior Face	Exterior Face
MOS-1290-03	Exterior Walls - Type III	2hr	2hr
MOS-1290-04	Exterior Walls - Type V & IRC	1hr	1hr
MOS-1290-05	NFPA 285 Compliance Table (Type III)		
MOS-1290-06	Exterior Walls - Type III	2hr	1hr
MOS-1290-07A/B	Townhome Separation Walls	2hr	
MOS-1290-08	Townhome Separation Walls	2hr	

Exterior Walls

EXACOR® panels can be used as an exterior sheathing panel in load-bearing exterior wall assemblies that are required to be fire-resistance rated. Due to its fire-resistive nature, EXACOR® sheathing is well suited for applications in fire-rated exterior walls that are near or adjacent to property lines and therefore require additional fire-resistance. Fire-resistance rated exterior wall assemblies with EXACOR® sheathing feature fire-resistance ratings applied to both sides of the wall to simplify meeting code requirements related to Fire Separation Distance (FSD).

In Construction Type III under the IBC, exterior wall assemblies greater than 40ft in height above grade plane trigger requirements to comply with NFPA 285. Select exterior wall assemblies with EXACOR® sheathing have been evaluated for compliance with NFPA 285. Please refer to ESL-1290, ICC Design No. MOS-1290-05, for NFPA 285 compliant assemblies with EXACOR® sheathing.

EXACOR® sheathing is intended to be used as exterior sheathing and should not be used as a replacement for interior gypsum wall board or other interior finish elements.

Townhome Unit Separation


EXACOR® sheathing can be used as part of an assembly to meet the requirements of the IRC for townhome separation by constructing two 1-hour rated walls as detailed in ICC Design No. MOS-1290-04 or by constructing a double wall in accordance with ICC Design No. MOS-1290-07A/B. EXACOR sheathing should be installed to face inward, or toward the non-occupant side of the wall as it should not be used as an interior finish panel. Always follow local code requirements for fire-resistance rated construction and townhouse separation. For more information on the use of EXACOR in townhomes, please see our [Technical Tip Townhome Separation Walls with EXACOR® Sheathing](#).

EXACOR® sheathing is not a direct replacement for gypsum shaft liner products. The use of EXACOR in townhome separation walls is limited to double walls as described in IRC R302.2.1.

EXACOR® Wall Sheathing

ICC Design No. MOS-1290-03


Load-Bearing - 90% Design Load
2hr Fire-Resistance (From Both Sides)

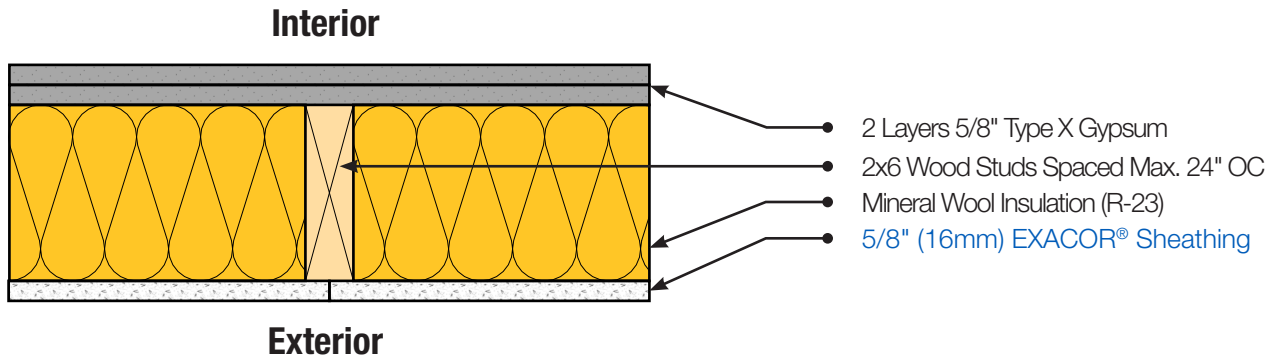

*See applicable ICC-ES Design for full assembly details and requirements.

ICC Design No. MOS-1290-04

Load-Bearing - 90% Design Load
1hr Fire-Resistance (From Both Sides)

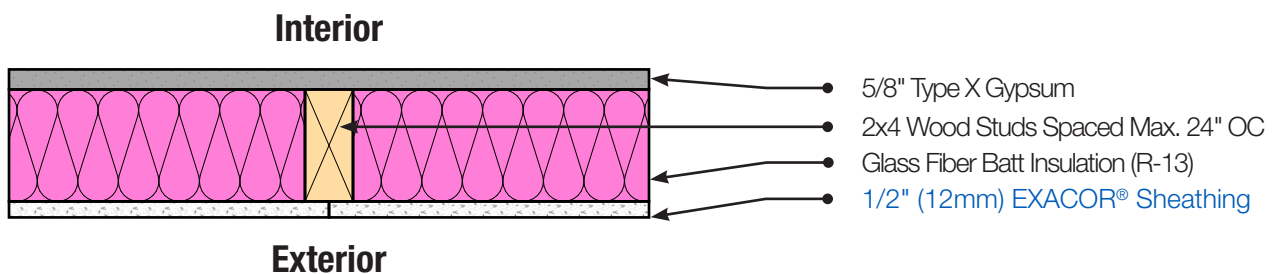


*See applicable ICC-ES Design for full assembly details and requirements.

EXACOR® Wall Sheathing

ICC Design No. MOS-1290-06

Load-Bearing - 80% Design Load

2hr Fire-Resistance From Interior (1hr from Exterior)

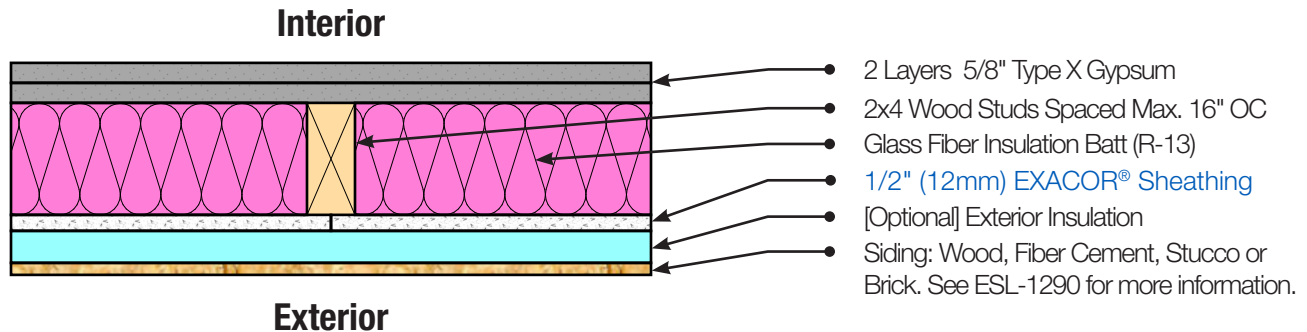


*See applicable ICC-ES Design for full assembly details and requirements.

ICC Design No. MOS-1290-08

Non-Load Bearing

2hr Fire-Resistance (From Both Sides)

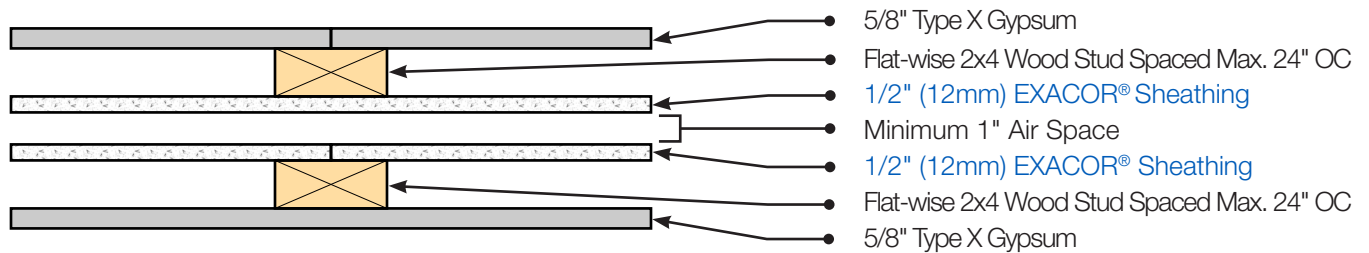


*See applicable ICC-ES Design for full assembly details and requirements.

EXACOR® Wall Sheathing

ICC Design No. MOS-1290-07A

Load-Bearing - 90% Design Load

2hr Fire-Resistance (From Both Sides)

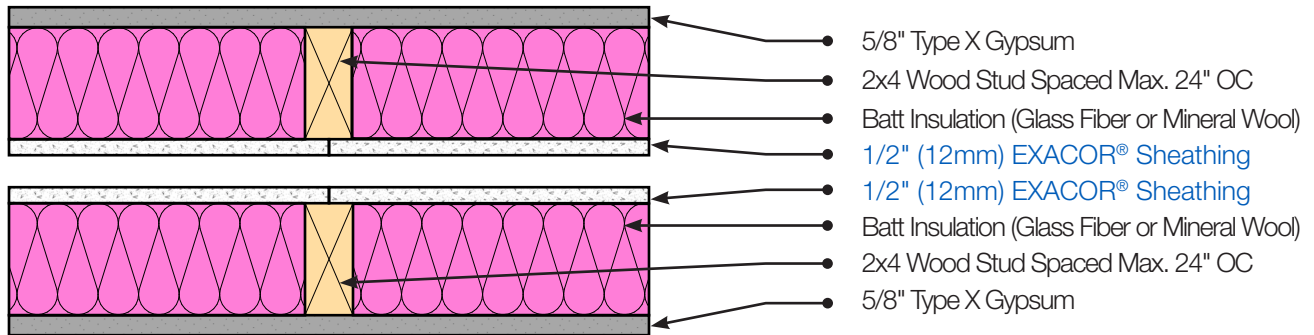

*See applicable ICC-ES Design for full assembly details and requirements.

Acoustical Performance - EXACOR Sheathing				
Air Cavity Size	Insulation Type	Resilient Channel*	STC	Report No.
1"	Glass Fiber Batt	None	44	TL22-223
		Single Side	49	TL22-224
		Both Sides	60	TL22-225
2"	Glass Fiber Batt	None	45	TL22-228
		Single Side	53	TL22-227
		Both Sides	58	TL22-226
	Mineral Wool Batt	None	43	TL22-229
3"	Glass Fiber Batt	None	48	TL22-230
4"	Glass Fiber Batt	None	48	TL22-232
	Mineral Wool Batt	None	48	TL22-233


*Resilient channel attached to studs on occupant side(s) of wall. Gypsum wallboard attached to resilient channel.

EXACOR® Wall Sheathing

ICC Design No. MOS-1290-07B

Load-Bearing - 90% Design Load

2hr Fire-Resistance (From Both Sides)

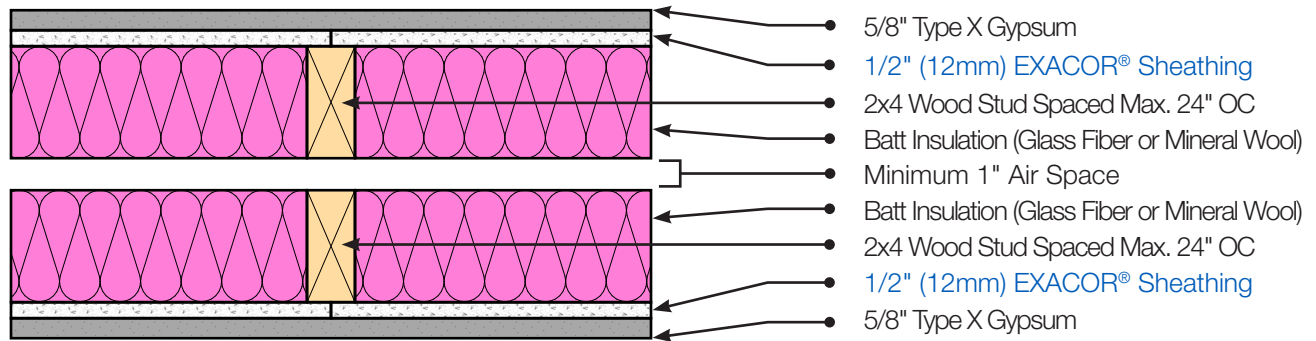

*See applicable ICC-ES Design for full assembly details and requirements.

Acoustical Performance - EXACOR® Sheathing				
Air Cavity Size	Insulation Type	Resilient Channel*	STC	Report No.
1"	Glass Fiber Batt	None	65	TL22-234



Technical Inquiries:

Huber Engineered Woods LLC
800.933.9220 x2716
techquestions@huber.com
exacor.com